

2017 REPPIR Report of Assessment

Hinkley Point B Power Station



Contents

1.	Preface	3
2.	Purpose	5
3.	Background	6
4.	Report of Assessment	7
4.1	Operator Details	7
4.2	Premises Details	7
4.3	Date of commencement of work with ionising radiation	7
4.4	Local area information	7
4.5	Radioactive substances on site	10
4.6	Site plan and environs map	12
4.7	Plant and enclosed systems	13
4.8	Factors precipitating a major release of radioactivity	16
4.9	Factors precipitating a smaller release of radioactivity	20
4.10	Factors precipitating the initiation of a self-sustaining chain reaction	20
4.11	Management systems and staffing arrangements	21
4.12	Local population information	24
4.13	The area likely to be affected by the dispersal of radioactive substances	25
4.14	Likely exposures to ionising radiation	26
4.15	The necessity for an Operator Emergency Plan	28
5.	Definitions	29
6.	References	30

Statement of Redaction

It has been necessary to remove a small amount of sensitive information from this publically available Report of Assessment. The redaction of this information has been undertaken in accordance with Regulation 16(6) of REPIR and with the approval of the Office for Nuclear Regulation.

1. Preface

The nuclear power industry in the UK has a long history of safe operation. The safety standards used in the design, construction, operation and maintenance of nuclear installations reduce to a very low level the risk of accidents that could have a consequence for the general public. Nonetheless, prudence requires the preparation of plans for dealing with such events. The Nuclear Installations Act, controls the activities on civil nuclear installations in the UK, and requires, under the license granted, that adequate emergency arrangements are in place.

The UK, as a member state of the EU, introduces legislation to implement Council Directives. To implement the articles on intervention in case of radiation emergency in Council Directive 96/29/Euratom on the Basic Safety Standards Directive for the protection of the health of workers and the general public against the dangers arising from ionising radiation (the BSS96 Directive) the Radiation (Emergency Preparedness and Public Information) REPPIR 2001 and Ionising Radiation Regulations 1999 have been made under the HSWA 1974 (except REPPIR Regulation 17 which is made under the European Communities Act 1972).

Emergency Preparedness for accidents that may affect members of the public involves many external organisations, such as the local authorities and emergency services. The REPPIR regulations have been developed alongside two other pieces of legislation, the Control of Major Accident Hazards Regulations and the Pipeline Safety Regulations. It is considered beneficial to responding organisations if legislative requirements for emergency preparedness, which affect them, are similar for different industries. Also some operators are active in more than one of these major hazard sectors. The introduction of REPPIR did not replace the requirements of the Nuclear Installations Act, but consolidated and enhanced the approaches taken to emergency planning for accidents at Hinkley Point B Power Station.

The principal hazard to the public from most accidents at nuclear power stations will be the release of materials that emit ionising radiation. The risk to people and the health effects from exposure to ionising radiation have been the subject of intensive study and research for many decades. The results of this work have been used by the International Commission on Radiological Protection [ICRP] to make recommendations on the principles to be adopted for protection against ionising radiation and a system of dose limitation, both for people exposed to radiation at work and for members of the public in the event of accidents.

Everyone is exposed continuously to natural sources of radiation. Many people receive additional low doses of radiation from artificial sources such as medical X-rays. The principal harmful effect of small doses of radiation is to increase the probability of cancer induction in later years, but very high doses can lead to other serious illnesses in the short term. Although a direct relationship between radiation dose and harmful effects has been observed only in people exposed to relatively high doses of radiation, for the purposes of radiological protection it is assumed that any dose of radiation, however small, carries with it some risk to health. In making its recommendation on annual limits of radiation dose to workers and members of the public, the ICRP has used this cautious assumption.

Public Health England - Centre for Radiation, Chemical and Environmental Hazards [PHE-CRCE], an independent statutory body within the UK, has specified Emergency Reference Levels [ERL] using the ICRP recommendations on intervention. ERLs are levels of radiation dose to the public which would justify introducing a given countermeasure to stop people receiving such a radiation dose. The application of the various countermeasures - evacuation, sheltering and the issue of tablets containing stable iodine and the control of foodstuffs and water supplies - are based on these ERLs. The PHE-CRCE has balanced the risk from the potential radiation exposures and those that may be associated with the implementation of any of these countermeasures.

In the event of an emergency, current legislation requires the following five aspects to be included in the emergency response:

- a) the control of the accident at the site
- b) the assessment of the actual and potential accident consequences and alerting the relevant authorities and the public
- c) introduction of countermeasures to mitigate the consequences as regards [i] individuals who could be affected in the short term and [ii] longer-term effects such as the contamination of food supplies, land and adjoining waters
- d) information to the public affected or likely to be affected by the event
- e) the return to normal conditions

The Emergency Plan in place for Hinkley Point B Power Station is currently approved as adequate to deal with the items above. The Emergency Plan is based on fault study analysis and is drawn up against a Reference Accident for the site. The first concern is always to avoid any exposure to the public to radiation and therefore to rectify the fault before there is any danger to the public outside the site. Nevertheless, as soon as the fault occurs, the question of emergency action has to be considered and pre-determined actions, which might eventually lead to notification of off-site agencies and the public, would begin. Emergency actions to protect the public may therefore be initiated in circumstances where the accident does not develop to a stage that has significant off-site consequences.

Currently the emergency actions are based on (a) releases from a Reference Accident and (b) the principle of extendibility for releases beyond the design basis accidents.

- a) The releases from a Reference Accident are used to define a zone closely surrounding the installation within which arrangements to protect the public by introducing countermeasures are planned in detail.
- b) Emergency Plans need to be capable of responding to accidents which, although extremely unlikely, could have consequences beyond the boundaries of the area identified in (a) above, i.e. extendibility. The measures that are required to extend the detailed arrangements cannot be precisely planned because the nature and potential of accidents can vary, for example according to weather conditions, and the exact response would be based on an assessment made at the time. The response may make use of local and national plans prepared to deal with a wide range of emergencies.

In an emergency, those who normally provide services/carry out protective functions for the public will continue to do so but in a co-ordinated manner which has been carefully planned and rehearsed. A considerable number of different authorities will be engaged, each applying its expertise to the situation as it develops. This off-site emergency response depends on:

- a) co-ordination, both locally and nationally, between centres dealing with public protection and information and those dealing with the incident on the site, and
- b) in particular both a local and national facility for co-ordinating information and making public the best assessments that can be made

The national response for dealing with a nuclear accident follows the key principles applied by Government in responding to any civil emergency. Firstly, the initial response should be at a local level where control of an accident and its most immediate effects can be dealt with effectively. Secondly, there should be a single lead department to coordinate the Government's response at the national level. For nuclear emergency planning, the lead department is the Department of Business, Energy and Industrial Strategy (BEIS).

2. Purpose

As a nuclear licensed site under the Nuclear Installations Act, Hinkley Point B Power Station is required to “make and implement” adequate emergency arrangements (Licence Condition 11). The site also falls under the Radiation Emergency Preparedness and Public Information Regulations (REPPiR) which among other things require site operators to undertake a Hazard Identification and Risk Evaluation (HIRE) process. The purpose of the HIRE process is to identify if a radiation emergency could occur at the station, and if yes, whether a radiation emergency is reasonably foreseeable.

EDF Energy is required to prepare and submit a “Report of Assessment” on the results of the HIRE process to enable the Office for Nuclear Regulation (ONR), the UK nuclear regulator, to determine the area to be covered within the local authority’s off-site plan for the site.

A Report of Assessment for Hinkley Point B Power Station was last submitted to the ONR in April 2014. Under the regulations the operator is required to review the HIRE position every 3 years and if appropriate confirm that no change has occurred which affects their previous assessment. If a “material change” has occurred the operator must prepare a revised assessment.

There has been no “material change” to EDF Energy’s assessment of the previously assessed hazards and risk from this power station. However EDF Energy has chosen to resubmit a full Report of Assessment based on learning from the submission for Sizewell B Power Station in 2014.

This Report of Assessment follows the regulatory requirements set out in Schedule 5 of REPPiR which detail the minimum content of the report.

It is important to be clear over the extent of current nuclear emergency planning at Hinkley Point B Power Station. Although the focus is frequently the “Off-Site Emergency Planning Area” (previously referred to as the Detailed Emergency Planning Zone (DEPZ)), this is only one element within the off-site plans.

The Off-Site Emergency Planning Area is the area where detailed plans are required to manage the consequences of an off-site nuclear emergency which would include the provision of urgent countermeasures. Plans for other less urgent but equally important reassurance and protective measures (such as food restrictions) extend beyond the Off-Site Emergency Planning Area and will continue to do so. Furthermore, it has long been a principle in UK nuclear emergency planning that these detailed plans should provide a basis for a wider response, calling on more general contingency arrangements and other resources where necessary. This is the principle of “extendibility”.

3. Background

Hinkley Point B Power Station emergency plans, including the previous Off-Site Emergency Planning Area of 3.5km have existed since the site was commissioned in 1976.

The scale of off-site planning at Hinkley Point B Power Station was initially determined by the characteristics of what was previously called the “maximum credible accident” for the design of the Hinkley Point B AGR Reactor.

Hinkley Point B Power Station is sited alongside Hinkley Point A – a Magnox station that is now in the process of decommissioning and no longer requires an Off-Site Emergency Planning Area. The planning for Hinkley Point B has been previously influenced by the greater potential for off-site risk posed by Hinkley Point A when it was operational.

Since the REPPiR regulations came into force in 2001, the licensees for the Hinkley Point B Power Station site have provided submissions to the nuclear safety regulator drawing on the work that was carried out to satisfy that same regulator under their existing Site Licence Conditions. This led to the Hazard Identification and Risk Evaluation process and Report of Assessment for Hinkley Point B Power Station that was provided in accordance with the new REPPiR regulations continuing to provide the basis on which the extent of the Off-Site Emergency Planning Area and the wider off-site planning for the Hinkley Point B site were determined.

Following the Fukushima accident in 2011, the Government asked ONR’s Chief Nuclear Inspector to report to it on the lessons for the UK. Two substantial reports [Ref. 3 & 4] were published. ONR’s Chief Inspector also led the International Atomic Energy Agency’s team that visited Japan after the accident – a visit that led to a further authoritative report [Ref. 5].

In common with other UK operators, EDF Energy has itself initiated work to examine and address the lessons from Fukushima. Where relevant, this report also refers to these Fukushima reports and the conclusions within them relevant to the identification of the Reference Accident for Hinkley Point B Power Station.

In August 2013 ONR published a new Technical Assessment Guide [Ref. 6] to aid its inspectors when reviewing submissions under REPPiR. EDF Energy has also taken note of this document when producing this report.

4. Report of Assessment

This Report of Assessment has been developed to correspond to the specified content set out in Schedule 5 of REPIR [Ref.7]. Thus the topic headings follow those within Schedule 5 and in the same order for ease of navigation and reference.

This Report of Assessment is intended to be a distilled content of the HIRE process and as such makes reference to multiple technical documents rather than replicate existing information.

4.1 Operator Details

The name and address of the Operator of Hinkley Point B Power Station is:

EDF Energy Nuclear Generation Ltd
Barnett Way
Barnwood
Gloucester
Gloucestershire
GL4 3RS

4.2 Premises Details

The postal address of Hinkley Point B Power Station is:

EDF Energy Nuclear Generation Ltd
Hinkley Point 'B' Power Station
Near Bridgwater
Somerset
TA5 1UD

4.3 Date of commencement of work with ionising radiation

Work with ionising radiation has already commenced at Hinkley Point B Power Station. The station was commissioned in 1976. It started generating electricity on 5 Feb 1976.

4.4 Local area information

This section sets out the local geographical and environmental information for the area immediately around Hinkley Point B Power Station.

Geographical information

Hinkley Point B Power Station is located on a 19.4-hectare (48-acre) site in Somerset on the Bristol Channel coast, 5 miles (8km) west of the River Parrett estuary and is 13.36km North West of Bridgwater.

The reactor building is approximately on Ordnance Survey Grid Reference ST212461.

Hinkley Point B Power Station is located within the area of responsibility of Somerset County Council. The Station adjoins the Bridgwater Bay and a nature reserve, and is a popular location for birdwatching and fossil hunting.

Meteorology

[Ref.8]

The south-west peninsula forms the most southerly part of the British Isles. The sea which surrounds the area on three sides has the highest annual mean temperature of any sea area near to the UK, close to 11°C to 12°C. With winds mainly blowing from the sea the annual mean temperatures are close to this in coastal areas of Cornwall and the Scillies.

The sea reaches its lowest temperature in February or early March so that on average February is the coldest month in Cornwall and Devon. In this month the mean minimum temperature varies from rather more than 5°C in the Scillies, to around 1.5°C in inland Devon. Further north-east in Somerset and the Bristol area, where the influence of the sea is less, January is the coldest month with mean minimum temperatures between 1°C and 2°C.

July and August are the warmest months in the region with mean daily maxima ranging from around 19°C in coastal Cornwall to 21.5°C in inland areas of Somerset and around Exeter. Instances of extreme high temperatures are rare and are associated with hot air brought from mainland Europe on south-easterly winds accompanied by strong sunshine.

The mean frequency of air frost is less than 2 per year. It rises to 15-20 in coastal areas of Cornwall and Devon. Frequencies exceed 50 per year in inland low-lying spots in Somerset. The first air frost of autumn can be expected about mid-October inland in Somerset. The continuing warmth of the sea usually prevents coastal autumn frosts. Air frost in April is common and even in May is not unknown. Ground frosts follow a similar pattern to air frost. Most coastal locations have between 35 and 60 days per year, but in some eastern inland districts this rises to over 100 days per year.

The south west of England has a favoured location with respect to the Azores high pressure, when it extends its influence north eastwards towards the UK, particularly in summer. Subsidence associated with high pressure reduces cloud cover and in spring and summer when the sea is cool relative to the air there is little convective cloud over the sea. Coastal areas are then favoured by high sunshine amounts. Inland and especially near hills, convective cloud often forms and acts to reduce sunshine amounts.

Coastal areas in the south west have average annual sunshine totals above 1600 hours, the south (English Channel) coast being more favoured than the north (Bristol Channel) coast. The Channel Islands are the sunniest part of the UK with some places exceeding 1900 hours per year.

The air humidity is an important factor determining rainfall and the sea temperature largely controls this. The sea temperature off SW England is at its maximum in late summer and autumn and is coolest in late winter and spring, and as a result, rainfall tends to be most in autumn and least in spring.

Annual rainfall totals are about 850-900mm in the Scilly Isles. Most coastal areas of Cornwall and Devon have 900-1000mm, but up to double this amount falls on upland such as Dartmoor, Bodmin Moor and Exmoor. Areas to the lee of high ground have lower totals e.g. 800mm near Exeter and even 700mm in the low-lying parts of central Somerset. Further east, the Mendip Hills have annual totals exceeding 1100mm, while the Bath-Bristol area has totals around 800-900mm.

The highest rainfall is in December and January when the sea is relatively warm still and the Atlantic depressions are most vigorous. The months from April to July are the driest when the sea is relatively cool and the Azores high pressure system exerts more influence. August shows an increase of rainfall over July and starts the inexorable rise in rainfall into the autumn and early winter. Monthly rainfall is also very variable. Most months of the year have recorded totals below 20mm in coastal districts and many below 10mm. The highest monthly totals tend to be in the autumn and winter months.

The numbers of days with rainfall totals of 1mm or more ('wet days') tend to follow a similar pattern to the monthly rainfall totals. In coastal areas in winter about 15 or 16 days is the norm, but this decreases to 9 or 10 in late spring and summer. In Somerset and the Bristol area there are fewer days having 1mm or more throughout the year. In winter about 12 or 13 days is normal with about 7 to 9 in summer.

In the south west, snowfall is normally confined to the months from November to April, though upland areas may have brief falls in October and May. Snow rarely lies outside of the period from December to March. On average, the number of days with snow falling is less than 10 per winter in the islands and coastal districts of Devon and Cornwall, though slightly higher near to the upper Severn Estuary. About 8-15 days is typical of inland areas with the higher figure in the north east near to the border with Wiltshire.

Lying snow is not a frequent occurrence in the south west, and in lowland areas about a third of years do not record any snow lying. In the Scillies and coastal Cornwall and Devon less than 3 days per year is a typical average. This increases to 5-10 days per year inland with the higher figure applying to north eastern areas. Despite being the mildest region of the British Isles, the south west peninsula has experienced some of the most severe blizzards to affect the country. This is because of a set of circumstances that affect the UK only rarely. If bitterly cold easterly winds from Europe meet a slow

moving Atlantic depression situated off south west England, then a prolonged snowstorm accompanied by high winds is possible.

South-west England is one of the more exposed areas of the UK, with wind speeds on average only greater in western Scotland. The strongest winds are associated with the passage of deep depressions close to or across the British Isles. The frequency and strength of depressions is greatest in the winter half of the year and this is when mean speeds and gusts are strongest. November to March have the highest mean speeds with June to August having the lightest winds. The peak gust follows a similar pattern and in the past 30 years both December and January have both had gusts to over 80 knots.

Geology and hydrology

Section reference: [Ref.9] [Ref.10]

Hinkley Point B has consistent geological conditions comprising a thick series of mudstones with subordinate thin limestones belonging to the Lower Lias of the Jurassic Period. All the investigations have also shown that the individual limestone and mudstone beds display little lateral variation in thickness, making it relatively easy to correlate strata between boreholes and determine the geological structure of the site. In the area of the Hinkley B Power Station, the Lower Lias rocks dip gently to the north at about 5 degrees and have a thickness of about 80 metres. They are underlain by rocks of the Penarth and Mercia Mudstone Groups.

The depth of weathering on the B Station site is stated to be up to 7.62m (25 feet) below the original ground level which varied between +8.53m (28 feet) and +9.45m (31 feet) relative to Ordnance Datum. As the vessel foundations are at a depth of 8.8m below original ground level they are supported entirely by rock which is unaffected by weathering. The rock conditions below the vessel foundations are summarised as follows.

Within about 50 metres of the underside of the vessel foundations, the proportion of mudstone to limestone is approximately 4 to 1. The mudstones are dark grey, calcareous and moderately strong. Occasionally the bedding is well defined and accompanied by shaley partings. The thickness of individual mudstone layers varies considerably, being controlled by the spacing of the thinner limestones. The average spacing of the limestone layers in the Angulata and Upper Liasic Zones of the Lower Lias, which are the stratigraphical units closest to the vessel Foundation level, is shown to be approximately a metre.

The limestones are a lighter grey than the mudstones and are fine grained, argillaceous and strong. The average thickness of individual beds is around 0.2m. At a few levels there are groups of limestones separated only by very thin mudstones. The rocks are described as closely jointed with the prominent discontinuities being sub-vertical and generally spaced at between 0.3m and 0.6m. Individual joint planes generally extended only up to a metre vertically but were more persistent laterally. The joints tended to be open up to 3mm in the limestones but tightly closed in the mudstones.

This description cannot have been made solely from borehole cores so it probably relates to the rock down to a level of about 2.13m O.D. which was exposed in the deep trial pit excavated within the Reactor Building area in the 1966 investigation. It is likely that discontinuity aperture decreases and discontinuity spacing increases with depth below that level. Evidence to that effect is presented in the references in Figure 6.1.

Groundwater is found both in gravel layers within the Made Ground and within the Lower Lias bedrock. Groundwater plots show an area of elevated groundwater in the centre of the site. In the centre and northern part of the site, groundwater flow was indicated to be north and north east towards Bridgewater Bay. In the southern part of the site, the flow was to the south and south east towards the low lying marshland surrounding the site.

Tidal fluctuations close to the sea wall were noted but are not considered to have a significant impact on flow beneath the site as a whole.

Groundwater levels in the rock have been monitored at +4.08m (+13.4 feet) and +8.84m (+29.0 feet) and showed a rapid response to rainfall.

4.5 Radioactive substances on site

This section describes the radioactive substances which are present on-site at Hinkley Point B Power Station in excess of the quantities set out under Schedules 2 and 3 of REPPiR [Ref.7] and where it has been practical to do so, identifies radionuclides present and the likely maximum quantities of these. This section is broken down into the various sources of radioactive material including in use nuclear fuel, spent fuel, on-site stored waste and ancillary sources.

Reactor core fuel

The greater part of the radioactive substances present on-site is contained in the irradiated nuclear fuel. In its un-irradiated state (i.e. as brought onto site) the fuel contains very little radioactivity. However, exposure to the nuclear chain reaction and the radioactive decay of the products of that chain reaction causes the fuel to become highly radioactive. The radioactivity of fuel increases with irradiation in the reactor but decays when removed from the reactor.

Hinkley Point B reactors each contain 150 tonnes of fuel when fully charged. The typical inventory for a single AGR reactor core with zero radioactive decay is shown below [Ref.11]. Hinkley Point B has two reactors.

Nuclide	Element Inventory
Details removed from the publically available version of this document.	

Spent reactor fuel

Reactor fuel that has been used up is sent for reprocessing at Sellafield. Before this takes place the fuel is held on-site for a period of no less than 90 days to allow it to cool sufficiently for safe transport. Fuel is held in two locations on-site, the first is in the intermediate or "buffer" stores. Buffer stores are used to maintain spent fuel assemblies within a CO₂ atmosphere, cooled by an external cooling water supply until the heat produced by the fuel assembly drops to a level where it can be safely processed through the Irradiated Fuel Disposal route (usually dependent on irradiation). This also allows the short half-life fission products to decay.

During Irradiated Fuel Disposal, the spent fuel assemblies are dismantled, after which the individual fuel elements are transferred to the station's Irradiated Fuel Storage Ponds, and other non-fuel assembly components are sent to the waste vault.

The maximum likely inventories within ex-reactor irradiated fuel on-site are as follows. The radionuclides are generated from [Ref.12].

Nuclide	Maximum Buffer Store Capacity	Maximum Pond Capacity
Details removed from the publically available version of this document.		

Irradiated waste

By their nature, operations at a nuclear power station generate waste, of which some of this is irradiated. Whilst of much lower levels of radiation than the spent reactor fuel, some of these wastes have been identified as likely to be above the limits identified in schedule 2 of REPPiR. These wastes can take either solid or liquid (including sludge) form.

The maximum volumes of waste which could be stored on-site are:

- Solid irradiated waste ~ 1444m³

Specific quantities of irradiated wastes on-site are recorded and monitored as part of the Nuclear Decommissioning Authorities "UK Radioactive Waste Inventory" [Ref. 13]. The specific waste identified as being above REPPiR schedule 2 levels are:

Stream ID	Waste material	Type
3N01	Ion Exchange Resin and Sand	ILW
3N02	Sludge	ILW
3N38	Miscellaneous Activated Components & Fuel Stringer Debris - Debris Vault 1	ILW
3N39	Miscellaneous Activated Components & Fuel Stringer Debris - Debris Vault 2	ILW
3N40	Miscellaneous Activated Components & Fuel Stringer Debris - Debris Vault 3	ILW
3N41	Miscellaneous Activated Components & Fuel Stringer Debris - Debris Vault 4	ILW

The Waste Inventory Data for Hinkley Point B, available via the UK Radioactive Waste Inventory, provides the current quantities of each of these wastes, predicted maximum quantities through the life of the plant, material composition and the average radioactive per m³. The full details are not replicated here for purposes of brevity.

Reactor components and additional materials

There are a number of additional materials within the station that become irradiated as part of normal plant processes. Some of these materials are fixed in place within structures with no plausible mechanism for release.

Irradiated fuel storage ponds

Activity in the fuel storage pond water potentially arises from leaking of activity from graphite fuel sleeves, fuel clad and fuel clad oxides. This arises as a result of in reactor activation of component elements, impurities and surface deposits. Pin surface activity can also arise from contamination with trace amounts of uranium and activity in deposited graphite. The table below [Ref.14] sets out a likely bounding level of pond water activity based upon a pond volume of 1E+06 litres. It should be noted that pond water would normally be kept at levels significantly lower than these upper limits.

Nuclide	Pond Equilibrium Activity
Details removed from the publically available version of this document.	

Reactor coolant

Through normal operations, the CO₂ coolant gas used in the reactor absorbs radioactivity through its contact with the fuel elements.

The activity of the coolant gas is set out below [Ref.15].

Nuclide	Activity In Coolant Gas
Details removed from the publically available version of this document.	

Graphite moderator

Within the reactor graphite is used to moderate the speed of neutrons given off during the fission process in order to maintain the conditions necessary for a controlled chain reaction. Through the life of the station this graphite is irradiated by the nuclear fuel. The reactors at Hinkley B Power Station contain ~ 2297m³ or 2926t.

Whilst calculating the current radionuclide content is not practical, the forward estimation of this graphite when it becomes waste as part of plant decommission is identified as part of the Nuclear Decommissioning Authorities "UK Radioactive

Waste Inventory” [Ref. 13] under stream IDs 3N313 and 3N317. However, it should be noted the activities quoted are for the time at which this waste will arise (i.e. ~85 years after end of generation).

Containment materials

The reactor pressure vessel itself contains materials which have become irradiated through normal operations. Again, whilst identifying specific current activity levels is not practical, the decommissioning estimates identify the quantity of materials and likely activity levels at the time this material becomes waste [Ref 13].

Stream ID	Containment Material	Approximate Quantity
3N311	Stainless Steel (Reactor) ILW	194 m ³
3N312	Mild Steel (Reactor) ILW	591 m ³
3N314	Stainless Steel (Reactor) LLW	1270 m ³
3N315	Mild Steel (Reactor) LLW	2406 m ³
3N318	Concrete (Reactor and Non-Reactor) LLW	1020 m ³
3N319	Miscellaneous Metals and Materials (Reactor and Non-Reactor) LLW	1049 m ³

4.6 Site plan and environs map

Figure 1 provides a plan of the site, while Figure 1 shows Hinkley Point B Power Station in its local context on an Ordnance Survey map.

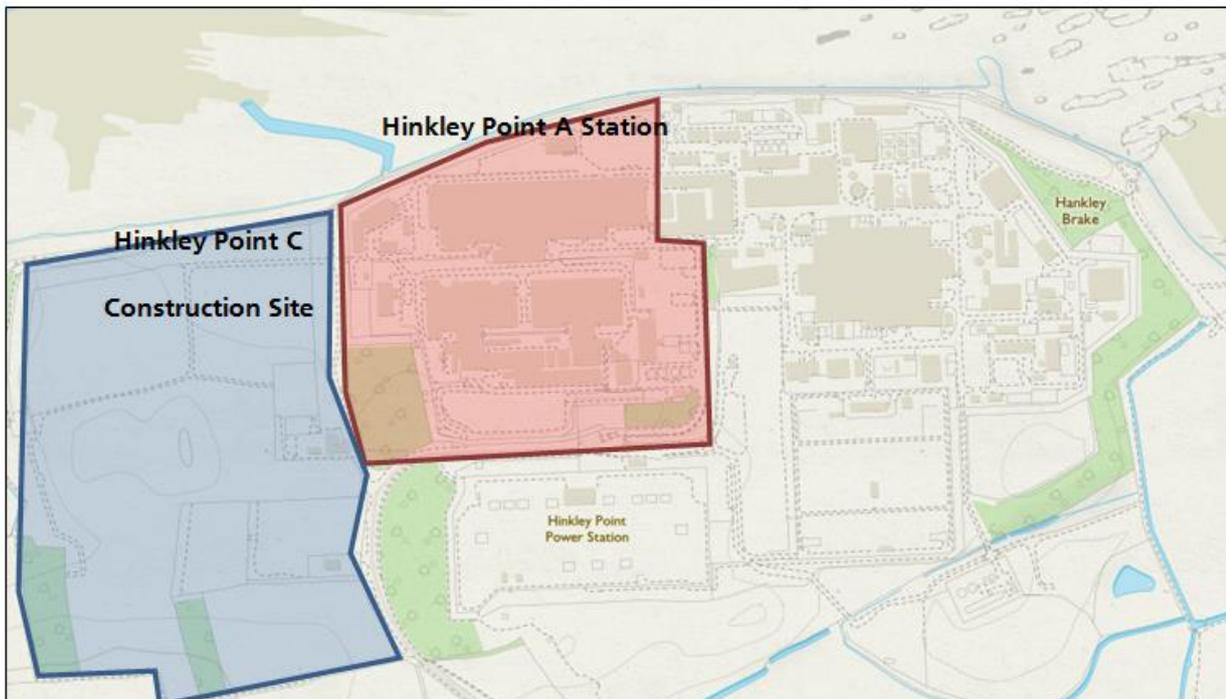


Figure 1 Hinkley Point B Power Station Site Plan [Ref.16]



Figure 2 Hinkley Point B Power Station Environs [Ref.16]

4.7 Plant and enclosed systems

This section details the plant and enclosed systems that contain more than the quantities of radioactive material identified in schedules 2 and 3 of REPIR. The principal plant and enclosed systems are:

- Reactor Core and Pressure Vessel
- Irradiated Fuel Buffer Store
- Fuel Storage Pond and Pond Water Treatment Plant

PLEASE NOTE – The descriptions of plant items in this section are generic for a typical AGR power station and do not specifically describe the exact plant and systems found at Hinkley Point B.

Reactor core and pressure vessel

The Reactor core, boilers and gas circulators are housed in a single cavity, pre-stressed concrete pressure vessel, (see Figure 3).

The reactor core is designed to act as a moderator and to provide individual channels for fuel stringer assemblies, control rods and coolant flow.

The reactor core is a massive sixteen-sided stack of graphite bricks. The bricks are interconnected with graphite keys to provide the assembly with stability and to maintain the vertical channels on their correct pitch, despite dimensional changes due to, for example, irradiation, pressure loads or thermal stresses.

The complete assembly comprises an inner cylinder of moderator graphite containing 408 fuel channels and 57 control rod channels surrounded by neutron reflector and shield graphite. The graphite structure is maintained in position by a steel restraint tank surrounding the graphite and is supported on a system of steel plates.

The graphite core is covered by an upper neutron shield of graphite and steel bricks and mounted on a lower neutron shield of graphite bricks that rests on the steel plates. Side shielding is in the form of steel rods located in the two outer rings of graphite bricks. Additional shielding is provided by steel plates fastened to the steel restraint system.

The shielding reduces radiation levels outside the core, so that when the reactor is shut down and depressurised, access is possible to the boilers and all plant inside the reactor vessel, except the plant within the core.

The graphite core and shielding are surrounded by a steel envelope called the gas baffle and supported on a steel grid called the diagrid. The diagrid is, in turn, supported by the peripheral skirt that forms the lower end of the gas baffle cylinder. The main functions of the gas baffle are to produce a downward flow of coolant gas through the core and to separate the hot from the cold gas [Ref. 17].

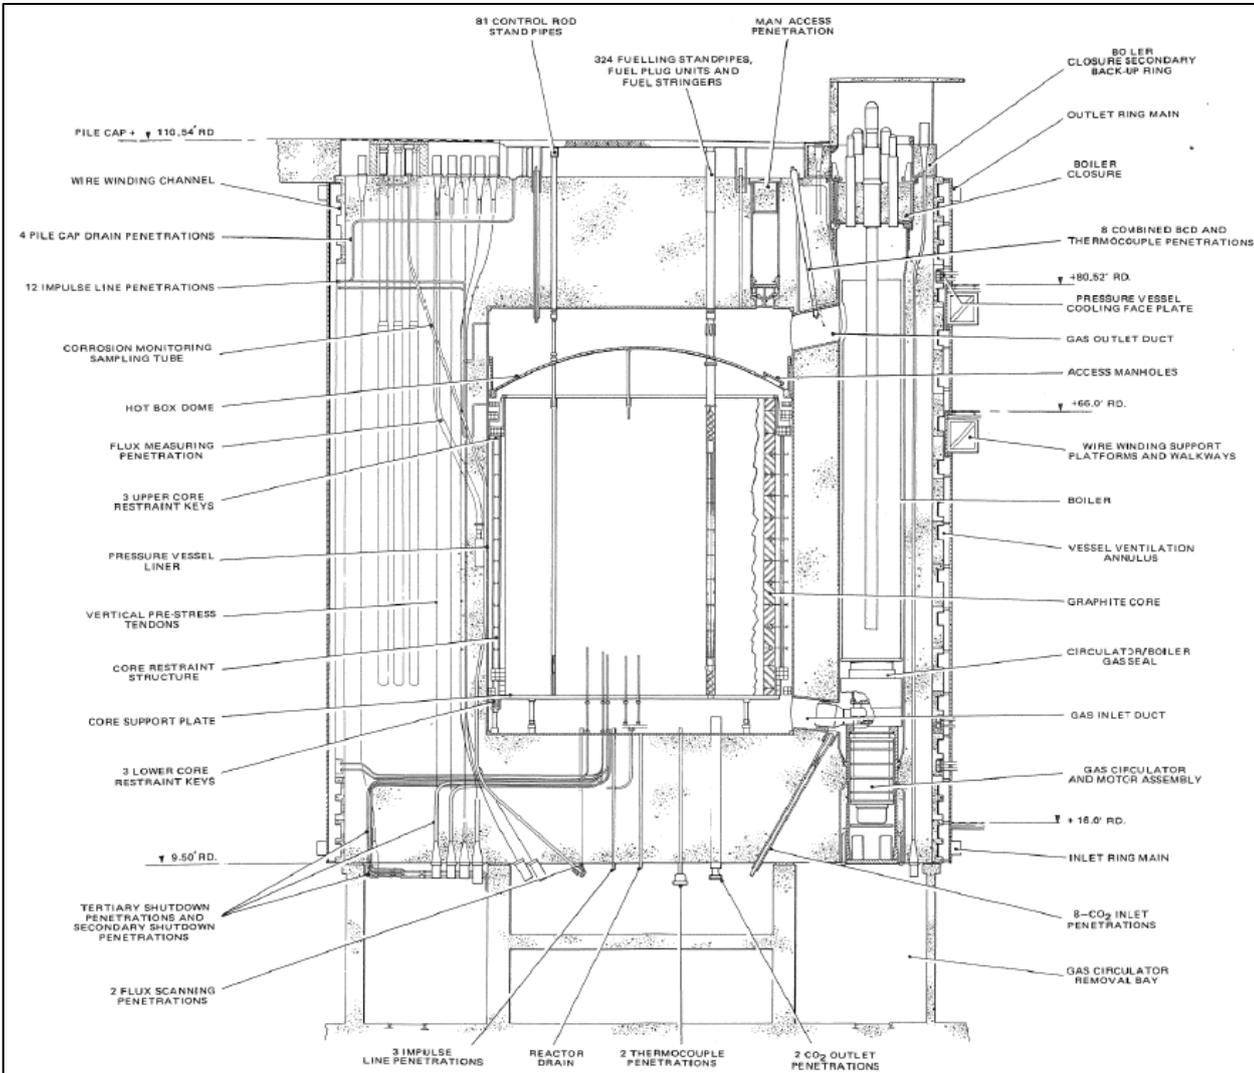


Figure 3 Typical AGR Reactor and Pressure Vessel

Irradiated fuel buffer store

The buffer store acts as an intermediate storage for spent fuel assemblies when they are first removed from the reactor. Due to the heat levels within these assemblies, they cannot immediately be processed through the Irradiated Fuel Disposal route.

The fuelling machine takes spent fuel assemblies from the reactor and lowers them into a decay tube. They remain there, within a pressurised CO₂ atmosphere, cooled by an external cooling water supply until the heat produced by the fuel assembly drops to a level where it can be safely processed through the Irradiated Fuel Disposal [Ref. 18].

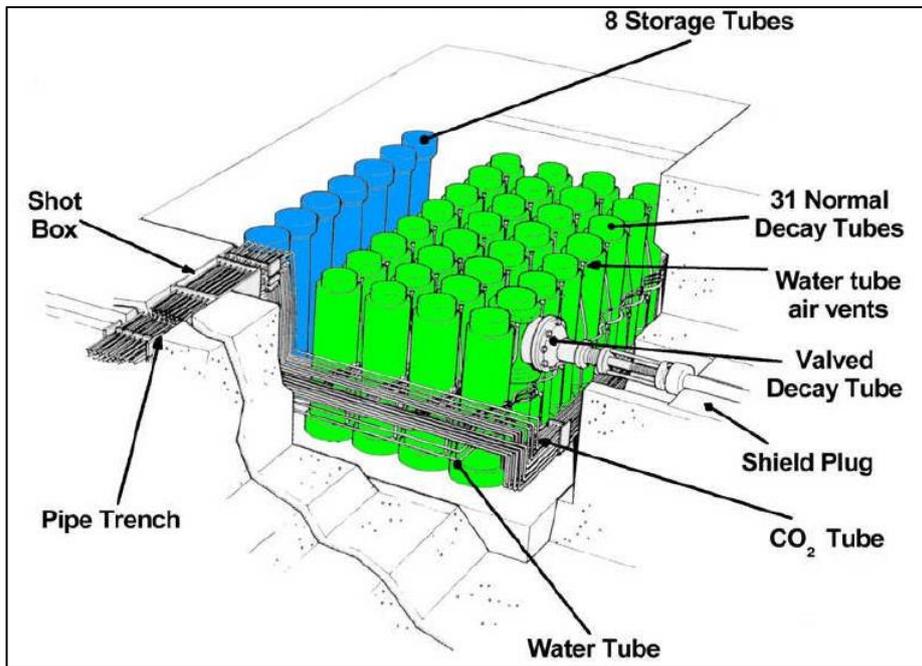


Figure 4 Typical AGR Irradiated Fuel Buffer Store [Ref.18]

Irradiated fuel storage ponds and pond water treatment plant

The purpose of the irradiated fuel storage ponds is to safely store irradiated fuel until the radioactivity and decay heat have reduced to an acceptable level before transportation to Sellafield for reprocessing or storage.

The irradiated fuel storage ponds are used for the storage of irradiated fuel elements discharged from the reactor and then processed through the Irradiated Fuel Disposal (IFD) cell. The pond water provides both shielding and cooling for the fuel during the storage period, before fuel is transported off-site in an Irradiated Fuel Transport Flask (IFTF) [Ref.19].

The pond water, in addition to cooling the fuel, provides the biological shield against gamma radiation from the spent fuel.

The fuel storage ponds are filled with boronated water in the form of boric acid to avoid any possibility of a criticality incident in the pond.

The basic functions and duties of the pond water treatment and cooling plants are as follows:

- to provide sufficient cooling to remove decay heat from stored irradiated fuel
- to maintain a pond water level sufficient to provide the necessary shielding
- to reduce the level of corrosion products by removal of any particulate or soluble impurities formed from the stored fuel
- to maintain the correct boron concentration and pH to reduce the risk of a criticality incident and to prevent corrosion of the fuel pins

It is also important to control pond water temperatures due to some important secondary considerations, one of which is that it will minimise airborne contamination due to reduced evaporation rates. Controlling pond water temperatures also reduces fuel-can corrosion rates as well as the rates that oxides will be dissolved in to the pond water, which is significant from a pond water chemistry viewpoint.

High pond water temperatures also have the potential to cause structural damage to the pond and its lining. Also, sudden chilling of the fuel elements as they enter the pond water, together with possible leaching of fission products from damaged fuel pins, releases oxides and other impurities into the pond water.

Hence, it is necessary to clean and cool the pond water, which is carried out by the Pond Water Treatment Plant (PWTP).

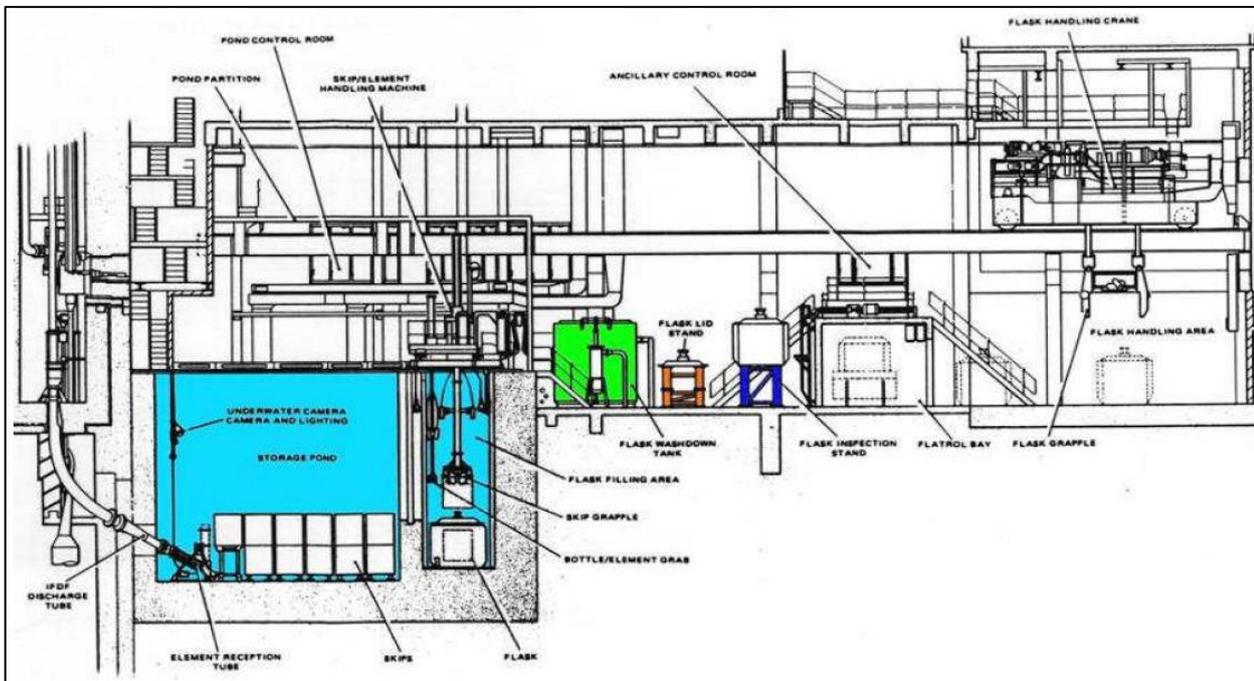


Figure 5 Typical AGR Fuel Storage Pond [Ref.19]

4.8 Factors precipitating a major release of radioactivity

A comprehensive review of the existing EDF Energy method for identifying the factors which could precipitate a major release of radioactivity has been undertaken as part of the HIRE process. The methodology for this review, agreed with the ONR, is set out in the report "HIRE Assessments for the AGRs" [Ref.21].

This involved:

- a review of the current reactor Probabilistic Safety Assessment (PSA) to identify relevant fault sequences that could lead to significant radiological releases
- identification of those faults that could be considered reasonably foreseeable (i.e. those with a frequency $>10^{-6}$ per reactor year)
- examination of identified fault sequences with an emphasis on the pessimisms/conservatisms built into the PSA
- identifying if there are any reasonably foreseeable fault sequences that result in a release above the previously identified AGR reference release
- consideration of faults other than for reactors at power in the Fuel Route and Radioactive Waste Facilities

The review concluded that after comprehensive interrogation of the AGR reactor PSAs, on the basis of the agreed methodology, there is no compelling reason to move away from the previously identified Reference Release as the basis for defining the DEPZ at any of the AGR sites. Faults in non-reactor facilities have been considered, and have been argued not to affect this conclusion.

In line with the methodology described in [Ref.21] a detailed review of the Hinkley Point B PSA fault sequences was carried out. This document [Ref.22] reviewed sequence information extracted from the 2014 Hinkley Point B PSA model (HNBV70 & HNBV71) and sorted to identify sequences with frequencies greater than 10^{-6} per year in each of the Dose Band (DB) 3, DB 4 and DB 5 consequences.

The detailed results of the review are shown in the tables in [Ref.22]. The sequences in each dose band are grouped by fault type in the subsequent discussion of which sequences are either demonstrably shown, or judged, to be bounded by the reference accident (see below).

PSA sequences in Dose Band 3, 4 and 5 with sequence frequencies greater than 10^{-6} per year have been reviewed. For all of these sequences, consideration of pessimisms and conservatism has shown that the frequency and/or dose is actually lower than assessed within the PSA, thus removing these sequences from consideration as the Reasonably Foreseeable Radiation Emergency.

The reference release was originally identified in [Ref.39]. This was issued following the development of the PSA for the AGRs, and made use of the PSA to consider a wider range of fault sequences/consequences than the previous deterministic approach to defining the off-site emergency planning area.

The introduction of the PSA highlighted that there does exist a range of very low frequency sequences that can give rise to very large releases, so that the deterministic concept of a maximum credible accident becomes inapplicable. The conceptual shift was instead to ensure that the frequency of having to implement the Emergency Plan, in order to protect the public by implementing effective countermeasures to avert dose, should be acceptably low.

A reference release was then considered. One of the approaches considered was to identify a release which would only be exceeded in more severe faults with a summed frequency less than 10^{-4} per annum (taking this as an appropriate value to correspond to "reasonably foreseeable").

In terms of Safety Review Guidebook release categories, the release is best represented as a multiple (~x3 based on 1311, ~x2 based on 137Cs) of CAT 6. CAT 6 releases of iodine are typically associated with depressurisation faults with failure of Post Trip Cooling, restored after 12 hours. In other words, the reference release does correspond to a very significant fault sequence.

A depressurisation fault with failure of Post Trip Cooling, restored after 12 hours, can be considered as a reference accident for AGRs

Hazard factors

A hazard is any event that could occur within or outside the site boundary that alters the environment in such a way as to prejudice safety. A hazard can cause a plant fault, or may be a consequence to a plant fault. Accordingly, there is a need to assess the safety of the reactor and its support systems, including Fuel Route, Radiological Waste and nuclear fuel storage facilities, against the consequences of Internal and External Hazards.

As with any recognised plant fault, it is important to understand how a fault or a hazard can present itself. This is achieved by identifying possible initiating events, the source of those events and the consequences of those events – both in terms of directly challenging the integrity of the reactor and its support system; and also by the initiation of further consequential events.

The Nuclear Safety Principles (NSPs) require consideration of internal and external hazards in safety cases. The NSPs define the design basis for external hazards as an event with an annual probability greater than or equal to 10^{-4} . Furthermore, the NSPs require the demonstration that there is no disproportionate increase in risk at reducing annual frequencies, i.e. no "cliff-edge" effect.

In 1996, the first systematic review of AGR safety cases against a list of potential hazards was completed as part of the first Periodic Safety Reviews (PSR1) for Hinkley Point B and Hunterston B. PSR1 considered a wide range of potential internal and external hazards explicitly and established the basis for a safety case with respect to these. The list of hazards was further developed as part of PSR2 by the which confirmed that Nuclear Safety Principal (NSP) 2.4 was consistent with the International Atomic Energy Agency (IAEA) recommendations current at that time, for the consideration of hazards within nuclear safety cases, with the notable exception that drought, biological fouling, electro-magnetic interference and lightning were not included in the NSP listing. The PSR2 formalised the requirement for these four hazards to be brought into the AGR safety cases. In 2013, after operational challenges at Hunterston B during previous years due to volcanic

activity in Iceland, and because of increasing concern over the potential impact of solar storms, two new hazards were added: Airborne Particulates and Solar Storms [Ref.41]

The potential hazards for Hinkley Point B Power Station, along with the rest of the EDF Energy AGR fleet, against which the Station Safety Case is reviewed, have been identified in the following report "Definitions of the Internal and External Hazards for the AGR fleet" [Ref.20]. The report identifies the following internal and external hazards.

Internal and External Hazards for the AGR Stations	
Internal hazards:	External hazards:
Fire	Seismic
Steam Release	Extreme Wind
Hot Gas Release	External Flooding
Cold Gas Release	Aircraft Impact
Missile Impact	Industrial Hazards
Dropped Loads	Extreme Ambient Temperatures
Internal Flooding & Corrosive Fluid Release	Lightning
Toxic Gas Release	Drought
Vehicular Impact	Biological Fouling
Electro-Magnetic Interference / Radio Frequency Interference (<i>considers external sources also</i>)	Solar Storms
	Airborne Particulates

A treatment of hazards sequences is included within the Probabilistic Safety Analysis, and the conclusion summarised in the above thus remains applicable when considering hazards as a specific class of fault.

Malicious hazard factors

The threats from malicious activity are not considered as part of the plant Probabilistic Safety Analysis and fault sequence studies reported in [Ref. 21] however the HIRE is required to evaluate all threats, including those of a malicious origin. A judgement is made that there is no significant probability of the conclusions of [Ref.21] being affected by consideration of malicious human activity and therefore that it is not reasonably foreseeable that malicious activity would lead to a radioactive release in excess of that bounded by the AGR Reference Release [Ref.28], for the following reasons.

- a. Individual fault sequences which challenge the agreed criterion for "Reasonably Foreseeable" in the PSA/fault sequence studies - i.e. frequencies greater than 10^{-6} pry (per rector year) giving rise to consequences more severe than DB3 - are generally sequences which involve an initiating event followed by complex combinations of plant protection and/or operator actions being unsuccessful in early termination of the sequence. Many of the initiating events involve boiler tube failures, for example. It is judged for these sequences that both the initiating events and the complex combinations would be impracticably difficult to influence deliberately.
- b. It is recognised that there are other initiating events which do not typically lead to challenges to the agreed criterion but which it would be more feasible to influence. These are faults against which the implementation of comprehensive Nuclear Site Security Plans, Security Cases and Integrated Protection Solutions are specifically designed to provide protection, and it is judged that these measures can be claimed deterministically to prevent damaging fault sequences.

Consideration of "all hazards arising"

Whilst this report predominantly focuses on the determined reasonably foreseeable reference release and associated faults identified in [Ref.21 &22], REPPiR regulation 4 requires investigation beyond this to encompass "all hazards arising... with the potential to cause an radiation accident". This includes accidents of a significant nature but with very low likelihoods of occurrence.

The methodology used to establish the reasonably foreseeable faults for the HIRE adopts the Probabilistic Safety Analysis (PSA) approach to looking for a reference accident/release. This means that all potential initiating events are considered (notwithstanding the comments in section 4.8.1.1) as part of the process.

The identification of low likelihood, high consequence events within the PSA has been supported by assessment of Beyond Design Basis Accidents [Ref.42]. Beyond Design Basis Accident Assessments conducted for Hinkley Point B considered faults frequencies up to 10^{-9} per year, which in the absence of operator intervention could lead to significant radiological releases. The postulated releases to the environment for beyond design basis accidents range over several orders of magnitude up to and including releases that encompass the total release of the core inventory of noble gases and volatile elements such as iodine and caesium and significant fractions of the less volatile and involatile elements.

Using existing severe accident fault studies, considerable work has been completed by EDF Energy, amongst other operators and agencies, since the Fukushima accident in 2011 to identify source terms for severe accidents [Ref. 40]. These include a range of postulated releases that increase in magnitude from the worst reasonably foreseeable accidents specified for REPPiR up to releases of significant fractions of the radioactive inventories.

The identification and analysis of severe accident hazards has enabled the development of response guidelines to tackle the consequences of such events to reduce the release of radiation. As identified by the ONR in their Technical Assessment Guidance – 82 A52 [Ref.6] – the measures to deal with such events cannot be as precisely planned as those for reasonably foreseeable incidents but should provide a framework for the response. The guidelines developed for severe accident management on-site include the Deployable Back Up Equipment Guidelines (DBUEG) [Ref.44 & 45] and Severe Accident Guidelines (SAGs) [Ref.27 & 43].

Off-site, the response to low likelihood, high consequence events is managed through the concept of extendibility which is described in the Off-Site Plan [Ref.34]. This is identified as good practice in the REPPiR guidance [Ref.2].

Protective measures

As an owner and operator of commercial nuclear power plant, EDF Energy is responsible for the safety of its employees and the public in respect of risks arising from normal operation and from any nuclear accident arising from its installations. There is therefore a fundamental legal requirement for risks to be As Low As Reasonably Practicable (ALARP). This responsibility is fully recognised by the Company and leads it to give the highest priority to the maintenance of nuclear safety standards in its nuclear power plants. The Companies approach to nuclear safety is set out in the Nuclear Safety Policy [Ref.48].

The Nuclear Safety Principles, to which EDF Energy conforms, have been defined taking into account the document issued by the Health and Safety Executive (HSE) entitled 'The Tolerability of Risk from Nuclear Power Stations' and subsequently developed further in 'Reducing Risks, Protecting People' (R2P2) which reflects current thinking on tolerable levels of risk, both to individuals and to society as a whole. The detail of the Nuclear Safety Principles is set out in Section 4 of the Nuclear Safety Principles for the Safety Review of the AGRs [Ref.26].

A significant number of measures are in place as part of the design and operation of Hinkley Point B Power Station to reduce the risk of significant radioactive releases occurring. The principle of defence in depth and redundancy is applied to the design of plant and protective systems.

The station operates under a set of parameters defined as the "safe operating envelope" [Ref.24]. This envelope represents a bounding condition from which fault transients can be assumed to start. The envelope is defined in "Technical Specifications" used to ensure that the plant always operates within safe parameters.

Protection systems for the reactor are identified in the Section 4 of the Hinkley Point B Living Safety Case [Ref.25]. Specific individual protection claims for faults are identified in the Hinkley Point B Living Safety Case Fault Based Studies documentation suite.

The response to a within design basis fault would be carried out utilising the post fault Station Operating Instructions (SOIs), and the Symptom Based Emergency Response Guidelines (SBERGs).

The SBERGs give advice in a developing fault situation, for which the normal operating instructions are not valid. This advice focuses on the symptoms of the fault rather than on specific failures in any one plant system. The SBERGs supply guidance on the most appropriate actions which would be needed to preserve and reinforce the critical safety functions, such as reactor cooling.

There are additional measures of protection for severe and beyond design basis accidents as described in section 4.8.1.2 above.

The Station Emergency Arrangements, as required under Site Licence Condition 11, form an integral part of the protective measures. The emergency arrangements are discussed in more detail in section 4.11 and are set out as part of the Site Emergency Handbook [Ref.46] and Site Emergency Plan [Ref.47].

Radioactive substances within a reference release

Details removed from this publically accessible document.

Plant which could precipitate a reference release

All the identified fault sequences identified in section 4.8.2 would originate in the reactor and pressure vessel, described in section 4.7.1.

4.9 Factors precipitating a smaller release of radioactivity

There are a considerable number of fault sequences within the Hinkley Point B PSA which could lead to a release of radiation at a lower level than those identified in section 4.8.2. These faults can be located in the Hinkley Point B Living Safety Case Fault Based View documents identified in [Ref.29]. Typical fault sequences include:

Sequences involving release of primary coolant with no or extremely limited pin failures such as:

- slow depressurisation faults with good post-trip cooling
- water ingress faults leading to Pres-stress Concrete Pressure Vessel (PCPV) Safety Relief Valve (SRV) lift and reseal;
- reactivity faults with successful trip, shutdown, post-trip cooling
- other pressurised faults with no initial post-trip cooling leading to PCPV SRV lift and fail to reseal (but successfully isolated)
- pressurised faults with no post-trip cooling for several hours resulting in multiple PCPV SRV lifts and reseals

Sequences involving release of primary coolant with some pin failures such as:

- slow depressurisation faults with reduced post-trip cooling
- fast depressurisation faults with good post-trip cooling
- water ingress faults with delayed post-trip cooling leading to PCPV SRV lift and reseal
- reactivity faults with interrupted post-trip feed

These faults would be controlled using the same measures identified in section 4.8.3.

4.10 Factors precipitating the initiation of a self-sustaining chain reaction

The initiation of an unintended self-sustaining chain reaction (criticality incident) in fissile material, or the loss of control of an intended self-sustaining chain reaction are serious incidents and significant efforts are put into procedures and processes to ensure that this does not occur.

Outside of the reactors there are a number of locations at the Station in which nuclear fuel may be handled or stored, and so be susceptible to a criticality hazard. These are referred to as the fuel route. The specific areas are identified in [Ref.30]

The factors that could precipitate a criticality incident in these areas are:

- the accumulation of quantities of fissile material above safe levels according to the level of U²³⁵ enrichment
- the positioning of fissile material in particular configurations
- the addition of moderator materials (such as water or graphite) to the environment containing fissile materials
- the occurrence of fire in an environment containing fissile materials

All operations involving storage, handling or movement of nuclear fuel on-site, which could conceivably constitute a criticality hazard (except when resident in the reactors) are carried out in accordance with the requirements of Criticality

Safety Certificates (CSC) as part of the Criticality Safety Case. The CSCs control all the factors above to ensure that unintended self-sustaining chain reactions do not occur.

The reactor core generates the heat required to produce the steam for the turbo-generators required for electricity generation. The heat is produced by a controlled self-sustaining chain reaction in the reactor fuel. The reactor is controlled with a series of Control Rods. Each reactor has a set of 81 independent control rod assemblies (CRAs).

The safety related functions of the CRAs are:

- to shut down the reactor when required
- to maintain a shutdown condition
- to regulate reactor power
- to control reactor fuel channel gas temperature
- to maintain reactor pressure boundary [Ref.32]

The failure of the CRAs to engage in the reactor core when required could lead to a loss of control of the intended self-sustaining chain reaction. The control rod system contains redundancies and is claimed in the Hinkley Point B Living Safety Case to operate in hazard conditions as per section 7 of [Ref.32]. The reactor design includes backup shutdown systems to mitigate against failure of the control rod system [Ref.33].

4.11 Management systems and staffing arrangements

The EDF Energy Nuclear Generation Ltd (NGL) management system describes how we manage the business and in doing so it:

- Defines how the management system integrates safety, health, environmental, security, quality and economic objectives to ensure that safety is not compromised. The management system draws on best practice, as defined within the International Atomic Energy Agency (IAEA) Safety Requirements No. GSR-3, The Management System for Facilities and Activities, together with BS EN ISO 9001, Quality Management Systems Requirements, BS EN ISO 14001, Environmental Management Systems – Requirements With Guidance For Use, BS OHSAS 18001, Occupational Health and Safety Management Systems - Requirements and BS ISO 55001, Asset Management, Management System – Requirements.
- Supports the achievement of the two general aims of a management system, as stated by the International Nuclear Safety Group on 'Management of Operational Safety in Nuclear Power Plants' INSAG-13:
 - To improve the safety performance of the organisation through the planning, control and supervision of safety related activities in normal, transient and emergency situations;
 - To foster and support a strong safety culture through the development and reinforcement of good safety attitudes, values and behaviour in individuals and teams so as to allow them to carry out their tasks safely.

The station Management System used at Hinkley Point B Power Station is developed to enable the Station Director to fulfil their responsibilities to direct and monitor all activities associated with the production of electricity – with nuclear safety being our overriding priority - in accordance with the Nuclear Site Licence, Statutory Requirements and Company policies, standards and procedures.

The Station Management System applies to all activities carried out by, or on behalf of, Hinkley Point B Power Station. It is designed to demonstrate EDF Energy Nuclear Generation Limited's (NGL) capability to generate electricity (our product) safely and reliably in compliance with applicable legal, statutory and regulatory requirements.

The Site Licence requires the responsibilities of each member of the Hinkley Point B management team be defined within a quality assurance programme for matters that affect nuclear safety.

Authority for Station operation to the requirements of the Nuclear Site Licence is delegated by the EDF Energy Nuclear Generation Limited Board (NGLB) through the Regional Chief Nuclear Officer to the Station Director. Hinkley Point B Station Director is responsible to the Regional Chief Nuclear Officer, Region 1.

The Station Management is divided into various departments:

- Operations
- Maintenance and Work Management
- Supply Chain
- Fuel Route
- Outage Management
- Engineering
- Technical and Safety Support (including Security)
- Performance Improvement (continuous improvement and training)
- Human Resources
- Finance
- Projects
- Lifetime Strategy Management

Station Director

The Station Director is:

- Responsible to the Regional Chief Nuclear Officer (Region 1) for ensuring that the Station Management System is established, documented, implemented, maintained, assessed and continually improved to meet stakeholder requirements
- Responsible for all aspects of the management of the station assets to deliver safe and reliable operation to meet plan targets and for bringing forward proposals for future resource deployment, asset operation, maintenance and improvement for incorporation into agreed Business Plans

Technical & Safety Support Manager (TSSM)

The TSSM is appointed by the Station Director as the Management Representative to support, develop and promote the Management Systems irrespective of other responsibilities and is responsible for:

- Ensuring that station management system arrangements align fully with company requirements and are implemented, maintained, monitored, audited and reviewed to assure their ongoing effectiveness
- Reporting the performance of the management system to the Station Director and recommending any requirement for improvement
- Acting as the single point of contact to oversee the Office for Nuclear Regulation (ONR) interactions

Engineering Manager

The Engineering Manager is responsible for:

- Providing support, guidance and assistance to all departments in the development, implementation and continual improvement of those parts of the management system directed to asset management
- Implementing and maintaining the site asset registers
- Reviewing the effectiveness of and identifying best practices and areas for improvement in the asset management aspects of the management system
- Providing the Station Director with reports on asset management performance

Station Lead Team

The responsibilities, accountabilities and authorities of members of the Station Lead Team are identified in Company and Station procedures and documents available via the Configured Document Management System (CDMS).

Additional services for the Station are provided by the Central Technical Organisation (CTO) including Asset Management, Central Engineering Support, Design Authority, Lifetime and Fleet Programmes, Projects, Supply Chain, Finance and Human Resources. Safety and Assurance provide Environmental Regulation and Oversight, Nuclear Fuel and Liabilities, Emergency Preparedness and Independent Nuclear Assurance (INA).

Staffing

Each department has a team of personnel, all of whom are suitably qualified and experienced for the work which they are expected to perform. The minimum required manning levels are fully documented in the departmental instructions.

A continuous shift system is operated at Hinkley Point B which ensures that there are adequate staff resources available at all times to operate the Site safely and to deal with any emergency situation which might arise. The level of staffing has been underwritten by a human factors assessment, which was undertaken as part of the probabilistic safety assessment.

Procedures

It is a requirement of the Nuclear Site Licence that adequate quality assurance arrangements are made and implemented for all matters that may affect safety. These arrangements are specified in the top tier of a multi-tiered system, and define the requirements for procedures and instructions across the Site. The lower levels are described below.

The top tier requirements for procedures and instructions are further developed on a departmental or system basis. Each system or department leader is responsible for the preparation and issue of sufficient instructions to enable work to be carried out to maintain safety is adequately controlled.

Conditions for the safe operation of the plant, and the work needed to maintain the plant in a safe and reliable condition, are specified in a range of documents and arrangements.

Regulatory Control

The Nuclear Industry is regulated by the Office for Nuclear Regulation (ONR) which has at least one inspector assigned for each licensed site. These inspectors have the right to inspect any equipment or procedure at short notice and the right to require the Company to provide information. The ONR can direct the shutdown of any process that it considers unsafe.

The ONR require that the safety of plant and operations is considered in a systematic manner at all stages from planning, building, operating and decommissioning and that the safety case is subject to both continuous review and formal periodic review.

Any significant changes in procedures, plant or management structure has to be approved by the ONR before the event, in accordance with nuclear site licence arrangements.

Emergency Organisation

Hinkley Point B has on-site emergency arrangements [Ref.46 & 47] that ensure that suitably qualified and experienced people are available at all times to respond to any events that cause the reactors or other equipment to deviate from their normal operating conditions. The provision of emergency arrangements can further mitigate the probability of a major release of radioactivity to the environment. Should a release of radioactivity occur, the off-site emergency arrangements are focused on implementing countermeasures to prevent the exposure of the public to radiation.

The local Police, Fire and Ambulance services form part of the integrated response to a site emergency. Mitigation actions carried out by the fire service would include firefighting, search and rescue and support to teams carrying out tasks in breathing apparatus. In providing assistance it is expected that emergency exposures may be required for Fire service intervention staff because of the proximity or duration of tasks to sources of radiation. Due to the nature of their role, it is not expected that emergency exposures would be required for Police personnel.

The emergency plans, both on-site and off-site, for Hinkley Point B are approved by the ONR and exercised regularly. Consultation and development of best practice in emergency planning for nuclear sites is discussed at consultation meetings involving key stakeholders. The BEIS led Nuclear Emergency Planning Development Committee (NEPDC) provides national guidance and co-ordination, and the Nuclear Emergency Arrangements Forum (NEAF) is a forum for operators to share practices. Locally the Emergency Planning Consultative Committee (EPCC) meets regularly to coordinate local plans, to allow consultation on changes, and acts as a focal point for planning issues.

4.12 Local population information

This information has been obtained from the Hinkley Point B Off-Site Contingency Plan [Ref.34].

Residential

There are 521 residential premises within the current Detailed Emergency Planning Zone as identified in the Off-Site Plan.

Sector(s)	Dwellings	Population	Remarks
1 – 4	0	0	
5	29	64	
6	5	10	
7	20	44	
8	17	38	
9	357	784	Sectors 9 & 10 are most populated adjacent/ downwind sectors – total population is 1,139 residents (part of Stogursey)
10	85	185	
11	8	13	
12 - 16	0	0	
Totals	521	1138	

Between 3.5 and 5km of the station the population is as follows:

Sector(s)	Dwellings	Population	Geographic Area
5	6	16	Farm/isolated house
6	75	172	Stockland Bristol, Otterhampton (North)
7	25	60	Farms/isolated houses
8	24	53	Cockwood, Isolated houses, farms
9	0	10	Farms, isolated houses
10	31	70	Stogursey (South) farms, isolated houses
11	7	16	Farm
12	6	15	Lilstock
13 – 16	0	0	
Totals	174	412	

Detailed information on vulnerable populations within the DEPZ can be found in the Off-Site Emergency Plan.

Transient

There could be a number of transient persons in the area of the station at any time, particularly likely in the area to the East of the site which includes the Bridgewater Bay Nature Reserve.

Commercial

Within the DEPZ the largest commercial population is that of the employees and contractors on the Hinkley Point Power Station sites. The workforce details are as follows:

Site/Location	Number	Remarks
HPA		
HPB		
HPC (construction)	1, 000	Construction site includes temporary jetty and sea wall construction. Maximum on-site during construction 5,600
HPC Complex (not constructed)	510	Included in total of 5, 600 (see Ser 3)
Public Information Centre (not constructed)	320	Included in "precautionary evacuation" arrangements see Paragraph 9.10 of Ref 34.

4.13 The area likely to be affected by the dispersal of radioactive substances

Dispersal for the "reference release"

This section identifies the area likely to be affected in the event of an incident up to and including the reference release as identified in section 4.8. The area of likely dispersion has been examined in detail in the document "The AGR REPIR Reference Release - Evaluation of Off-Site Doses" [Ref.35].

The report presents an evaluation of doses as a function of downwind distance for the AGR Reference Release for comparison to the 5mSv effective dose criterion in REPIR and the ERLs for early countermeasures to protect the public. It also considers the downwind distance to the Council Food Intervention Levels (CFIL) in order to estimate the potential extent of food bans. It uses the same methodology and evaluates many of the same quantities as were considered most recently for Sizewell B and so extends and supersedes the earlier analyses for the AGRs carried out at the time of the introduction of REPIR.

The methodology includes the extension applied after the methodology for Sizewell B [Ref.36] was produced to include the potential ingestion doses incurred in the first 24 hours which was required by the ONR since the Health and Safety Executive (HSE) guidance on REPIR [Ref.37] states that early health protection measures should be disregarded in this period and this is taken to include food bans.

Average dispersion conditions are required for the purposes of the assessment for the 5mSv effective dose criterion for REPIR and so Pasquill Category D conditions have been used. Therefore, the accepted representative values for this category of a wind speed of 5m/s and a mixing layer height of 800m have been used [Ref.38].

A release duration of 5 hours is implicit in the specification for the reference release [Ref.22 &39]. The duration of dispersal matches the release duration.

For the worst reasonably foreseeable accidents (bounded by the reference release) the following downwind distances have been determined:

- a. The 5mSv effective dose contour, evaluated for 1 year using average, category D, dispersion conditions for the purposes of REPIR, extends out to about 870m. It has been shown that the equivalent doses to the lens of the eye or the skin are less onerous than the effective dose.
- b. The short term effective dose falls to 3mSv, the lower ERL for sheltering, at about 680m under average dispersion conditions and at about 1600m under pessimistic, category F, dispersion conditions
- c. The short term effective dose falls to 30mSv, the lower ERL for evacuation, at about 180m under average dispersion conditions and at about 230m under pessimistic dispersion conditions
- d. The 500Bq/kg Council Food Intervention Level (CFIL) for iodine activity applicable to milk is estimated to occur out to about 43km under average dispersion conditions and out to about 44km under pessimistic dispersion conditions. The extent of the area corresponding to the 1000Bq/kg CFIL applicable to caesium activity in milk is very much smaller.

Dispersal beyond the “reference release”

Whilst the information in section 4.13.1 above identifies the impact of the reference release, which can be considered reasonably foreseeable, REPPIR requires the consideration of radiation emergencies which go beyond the limits of reasonably foreseeable.

Significant work has been undertaken for national projects to identify plant faults and source terms that go well beyond those specifically identified under the reference release [Ref.40].

These sets of severe accident source terms include a range of postulated releases that increase in magnitude from the worst reasonably foreseeable accidents specified for REPPIR up to releases of significant fractions of the radioactive inventories.

Durations of these postulated releases range into tens of hours as set out in Table 3 of [Ref.40]. 13 Source Terms for a range of severe accident scenarios are identified. The content of the document is classified Official-Sensitive and therefore not replicated in this report.

The derived source terms will enable the assessment of off-site dispersal distances in extreme scenarios through the incident assessment tools.

4.14 Likely exposures to ionising radiation

Effective dose for the “reference release”

In line with the assessment summarised in section 4.13.1 above, a number of tables have been produced which demonstrate the effective dose versus the downwind dispersal distance.

The calculated doses do not account for any countermeasures within the first 24 hours as required by REPPIR. The tables for effective and equivalent dose are shown below. A full list of dose tables is set out in [Ref.35].

Table 1: Effective Dose as a Function of Downwind Distance for the REPPiR 5mSv Dose Contour for the AGR Reference Release

Downwind Distance (m)	Effective Dose (mSv)		
	Adult	Child	Infant
50	71.1	106.6	155.7
100	55.6	83.2	121.2
150	43.9	65.6	95.3
200	20.5	30.5	44.3
250	9.8	14.5	21.1
300	8.2	12.2	17.7
350	7.0	10.4	15.1
400	6.1	9.0	13.0
450	5.3	7.9	11.4
500	4.7	7.0	10.1
550	4.2	6.2	9.0
600	3.8	5.6	8.1
650	3.4	5.1	7.3
700	3.1	4.6	6.6
750	2.8	4.2	6.1
800	2.6	3.9	5.6
850	2.4	3.6	5.1
900	2.2	3.3	4.7
950	2.1	3.1	4.4
1000	1.9	2.9	4.1
2000	0.7	1.0	1.5
3000	0.4	0.5	0.8
Interpolated Distance to 5mSv (m)	480	660	870

Table 2: Equivalent Dose to Lens of Eye and Skin as a Function of Downwind Distance for the REPPiR Dose Contour for the AGR Reference Release

Downwind Distance (m)	Equivalent Dose to Lens of Eye and Skin (mSv)		
	Adult	Child	Infant
50	32.68	45.36	58.00
100	26.81	37.22	47.60
150	21.88	30.40	38.87
200	10.45	14.52	18.57
250	5.08	7.06	9.03
300	4.34	6.03	7.71
350	3.75	5.21	6.67
400	3.28	4.56	5.83
450	2.90	4.03	5.15
500	2.58	3.59	4.59
550	2.32	3.22	4.12
600	2.09	2.91	3.72
650	1.90	2.65	3.38
700	1.74	2.42	3.09
750	1.60	2.22	2.84
800	1.47	2.05	2.62
850	1.36	1.89	2.42
900	1.26	1.76	2.25
950	1.18	1.64	2.09
1000	1.10	1.53	1.95
2000	0.41	0.57	0.73
3000	0.22	0.30	0.39
Interpolated Distance to 15mSv (Eye) (m)	180	200	220
Interpolated Distance to 50mSv (Skin) (m)	n/a	n/a	88

Calculated dose beyond the “reference release”

As stated in section 4.13.2, REPPiR requires the consideration of the impacts of radiation emergencies that go beyond what is considered reasonably foreseeable.

As part of the work to identify source terms for the severe accident faults used in national hazard assessment projects, the radionuclide release for the identified severe faults has been identified as per tables 7-20 of [Ref.40]. This includes the percentage contribution to total dose for each radionuclide.

When applied through incident assessment tools, this will allow for calculation of effective dose based on the current weather conditions.

4.15 The necessity for an Operator Emergency Plan

As a result of the assessments carried out by EDF Energy, and reported in sections 4.13 and 4.14 above, it is apparent that the Reference Release (the reasonably foreseeable accident with the largest consequences off-site), with no application of countermeasures would result in an effective dose of at least 5mSv in a 12 month period, and would therefore be classed as a Radiation Emergency under the REPPiR regulations. As a result of this definition, an Operator’s Emergency Plan is required under REPPiR. Notwithstanding this assessment, EDF Energy is also required under the Site Licence to prepare an Operator’s Emergency Plan.

5. Definitions

AGR	Advanced Gas-cooled Reactor
ALARP	As Low As Reasonably Practicable
BEIS	Business, Energy & Industrial Strategy
CFIL	Council Food Intervention Level
DB	Dose Band
DBF	Design Basis Fault
DBUEG	Deployable Back Up Equipment Guidelines
DEPZ	Detailed Emergency Planning Zone
EEPZ	Extended Emergency Planning Zone
EPCC	Emergency Planning Consultative Committee
ERL	Emergency Reference Level
HIRE	Hazard Identification & Risk Evaluation
HS&E	Health Safety & Environment
HSWA	Health & Safety at Work Act 1974
IAEA	International Atomic Energy Agency
ICRP	International Commission on Radiological Protection
IFDF	Irradiated Fuel Disposal Facility
IFTF	Irradiated Fuel Transport Flask
LPBUCS	Low Pressure Backup Cooling System
NEAF	Nuclear Emergency Arrangements Forum
NEPDC	Nuclear Emergency Planning Delivery Committee
NEPLG	Nuclear Emergency Planning Liaison Group
NSC	Nuclear Safety Committee
NSP	Nuclear Safety Principles
OD	Ordnance Datum
ONR	Office for Nuclear Regulation
PCPV	Pre-stress Concrete Pressure Vessel
PHE-CRCE	Public Health England – Centre for Radiological and Chemical Hazards
PSR	Periodic Safety Review
PWR	Pressurised Water Reactor
REPPIR	Radiation (Emergency Preparedness and Public Information) Regulations 2001
RoA	Report of Assessment
SAG	Safety Accident Guidelines
SAP	Safety Assessment Principles
SBERGs	Symptom Based Emergency Response Guidelines
SOIs	Station Operating Instructions
SRV	Safety Relief Valve
WENRA	Western European Nuclear Regulators' Association
Station Abbreviation Used (HPB)	Hinkley Point B Power Station

6. References

Ref No.	Doc No.	Doc Title
1	SPARE	SPARE
2	ISBN 978 0 7176 2240 5	A guide to the Radiation (Emergency Preparedness and Public Information) Regulations 2001
3	N/A	Japanese earthquake and tsunami: Implications for the UK Nuclear Industry by HM Chief Inspector of Nuclear Installations – Interim Report (May 2011).
4	N/A	Japanese earthquake and tsunami: Implications for the UK Nuclear Industry by HM Chief Inspector of Nuclear Installations – Final Report (September 2011)
5	N/A	IAEA International Fact Finding Expert Mission of the Fukushima Dai-ichi NPP Accident following the Great East Japan Earthquake and Tsunami. June 2011.
6	T/AST/082 – Issue 1	Technical Assessment Guide: The Technical Assessment of REPPiR Submissions
7	Statutory Instrument 2001 No. 2975	The Radiation (Emergency Preparedness and Public Information) Regulations (REPPiR) 2001
8	http://www.metoffice.gov.uk/climate/uk/regional-climates/ws	Western Scotland Regional Climate Summary (as of February 2017)
9	Removed	
10	Removed	
11	Removed	
12	Removed	
13	https://ukinventory.nda.gov.uk/	UK Radioactive waste Inventory
14	Removed	
15	Removed	
16	https://osmaps.ordnancesurvey.co.uk/	UK Ordnance Survey Mapping
17	Removed	
18	Removed	
19	Removed	
20	Removed	
21	Removed	
22	Removed	
23	SPARE	SPARE
24	Removed	
25	Removed	
26	Removed	
27	Removed	
28	Removed	

29	Removed	
30	Removed	
31	SPARE	SPARE
32	Removed	
33	Removed	
34	N/A	Hinkley Point B Nuclear Licensed Site Off-Site Emergency Plan
35	Removed	
36	Removed	
37	ISBN 978 0 7176 2240 5	A guide to the Radiation (Emergency Preparedness and Public Information) Regulations 2001
38	NRPB-R91	A Model for Short and Medium Range Dispersion of Radionuclides Released to the Atmosphere
39	Removed	
40	Removed	
41	Removed	
42	Removed	
43	Removed	
44	Removed	
45	Removed	
46	Removed	
47	Removed	
48	BEG/POL/006	Nuclear Generation Nuclear Safety Policy